


SPI/BIO CONTROL PANEL

RELIABLE WASTEWATER – JET INC. SYSTEM

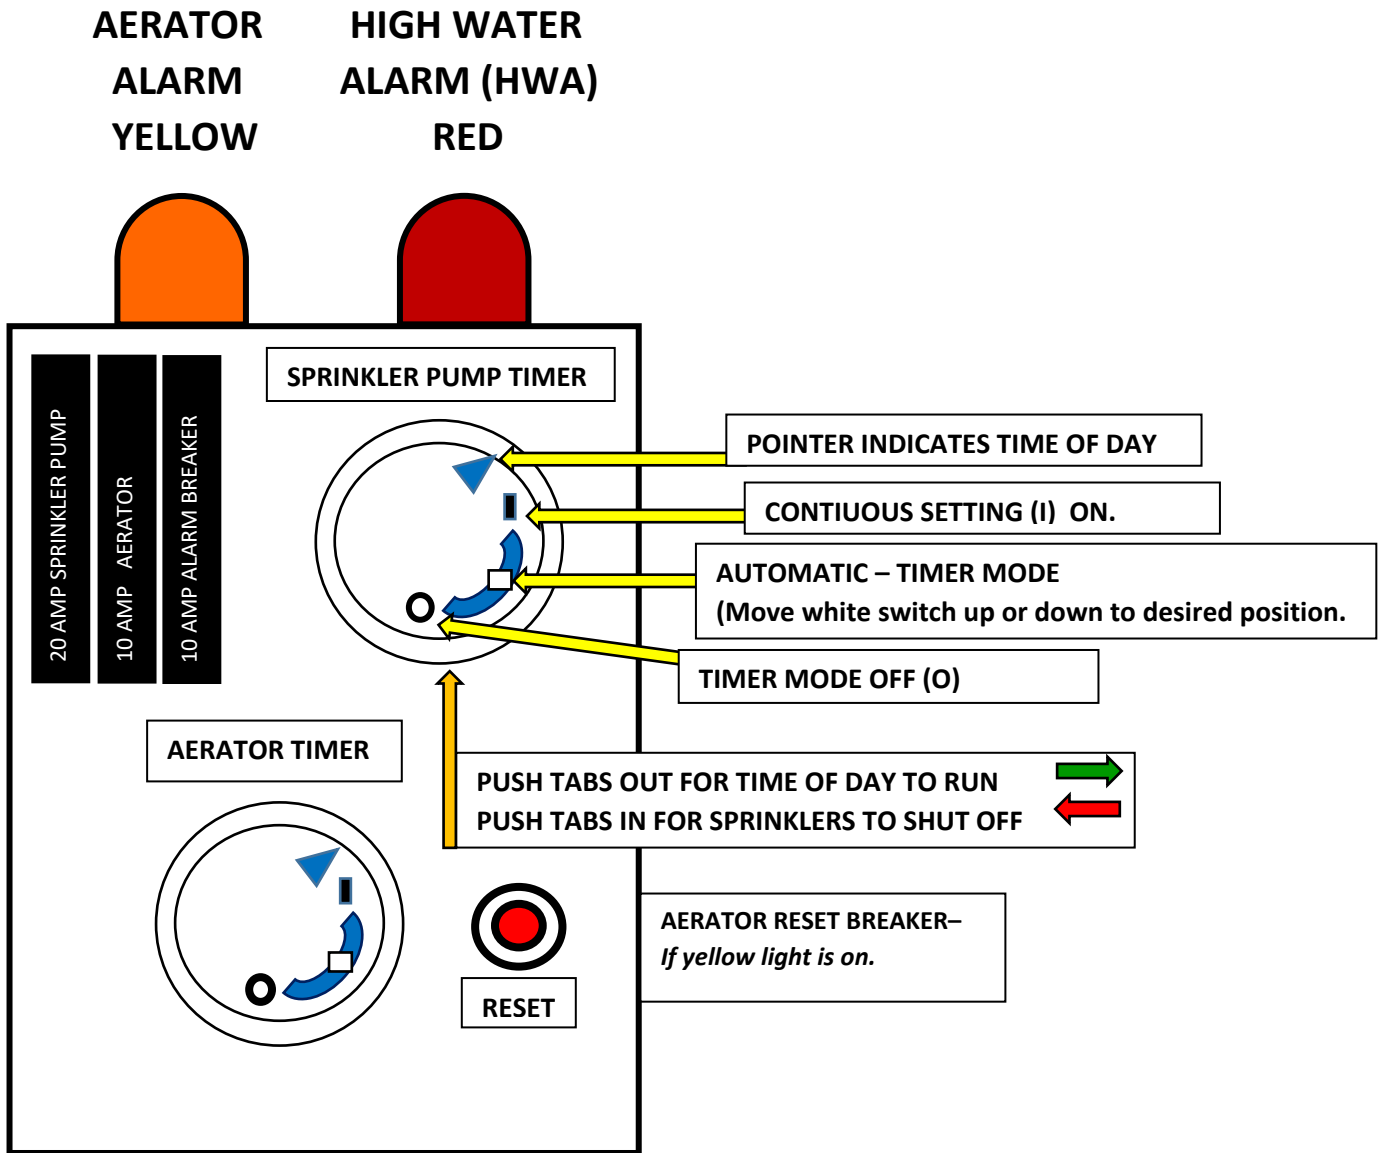

BOTH CLOCKS ARE SET THE SAME MANNER BY ROTATING THE MINUTE HAND CLOCKWISE SLOWLY. THE HOURS WILL INCREASE INCREMENTALLY BY ONE (1) HOUR FOR EVERY ROTATION.

THE TOGGLE SWITCHES ON THE RIGHT OUTSIDE OF THE BOX IN THE RUN POSITION, RUNS THE SYSTEM AS TO HOW THE TIMERS ARE SET.

THE TOGGLE SWITCHES IN THE MIDDLE POSITION WILL ONLY MUTE (TURN OFF) THE AUDIBLE ALARM.

THE TOGGLE SWITCHES IN THE BOTTOM POSITION ONLY TESTS TO SEE IF THE VISUAL AND AUDIBLE ALARMS ARE WORKING.

